


Ventilation Assessment Summary

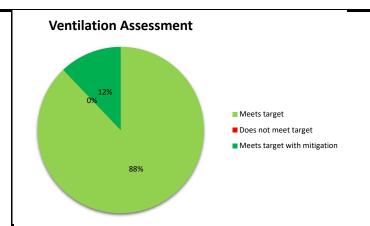

#	HVAC		Site			Α	Air Changes	Reccomendation		Mitigation
"	Room	Туре	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply	Applied CADR
1	<u>D208</u>	Classroom	College of Alameda	D	4	6.6	Meets target with mitigation	14	644	400
2	<u>D204</u>	Classroom	College of Alameda	D	3	14.8	Meets target	0	498	1200
3	D229	Classroom	College of Alameda	D	3	16.4	Meets target	0	317	1200
4	<u>D234</u>	Office	College of Alameda	D	3	5.6	Meets target	0	116	0
5	<u>D233</u>	Office	College of Alameda	D	3	7.4	Meets target	0	267	0
6	<u>D107</u>	Office	College of Alameda	D	3	5.5	Meets target	0	86	0
7	D109	Wood/Metal Shop	College of Alameda	D	3	34.3	Meets target	0	721	0
8	<u>D108</u>	Occupiable Storage (Dry)	College of Alameda	D	3	9.9	Meets target	0	70	0
9	<u>D110</u>	Occupiable Storage (Dry)	College of Alameda	D	3	27.4	Meets target	0	40	0
10	<u>D105</u>	Science Lab	College of Alameda	D	3	28.4	Meets target	0	268	0
11	<u>D114</u>	Office	College of Alameda	D	3	11.2	Meets target	0	1256	240
12	<u>D115A</u>	Occupiable Storage (Dry)	College of Alameda	D	3	9.1	Meets target	0	96	0
13	<u>D114C</u>	Office	College of Alameda	D	3	19.7	Meets target	0	31	0
14	<u>D115</u>	Science Lab	College of Alameda	D	3	9.9	Meets target	0	750	0
15	<u>D116</u>	Computer Lab	College of Alameda	D	3	8.5	Meets target	0	452	120
16	<u>D115B</u>	Office	College of Alameda	D	3	11.8	Meets target	0	53	0
17	<u>D117A</u>	Office	College of Alameda	D	3	7.0	Meets target with mitigation	72	79	167
18	<u>D117</u>	Office	College of Alameda	D	3	13.6	Meets target	0	297	360
19	<u>D117B</u>	Office	College of Alameda	D	3	7.9	Meets target	0	40	0
20	<u>D117D</u>	Office	College of Alameda	D	3	13.2	Meets target	0	40	0
21	<u>D117C</u>	Office	College of Alameda	D	3	7.7	Meets target	0	43	0
22	<u>D117E</u>	Office	College of Alameda	D	3	12.5	Meets target	0	42	0
23	<u>D117G</u>	Office	College of Alameda	D	3	9.7	Meets target	0	74	0
24	<u>D117F</u>	Office	College of Alameda	D	3	5.3	Meets target	0	61	0
25	<u>D124</u>	Office	College of Alameda	D	3	4.8	Meets target	0	110	0
26	<u>D118</u>	Office	College of Alameda	D	3	4.7	Meets target	0	62	0
27	D122	Break room	College of Alameda	D	3	4.9	Meets target	0	66	0
28	<u>D119</u>	Lecture Room	College of Alameda	D	3	8.6	Meets target	0	908	0
29	D202 AND D203	Office	College of Alameda	D	3	14.8	Meets target	0	361	1200
30	D202C	Office	College of Alameda	D	3	37.4	Meets target	0	50	400
31	<u>D202D</u>	Office	College of Alameda	D	3	23.2	Meets target	0	82	400

#	HVAC		Site		Air Changes Reccomendation		endation	Mitigation		
#	Room	Туре	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply	Applied CADR
32	D205	Classroom	College of Alameda	D	3	14.2	Meets target	0	452	1200
33	D202B	Conference	College of Alameda	D	3	32.2	Meets target	0	53	400
34	D202A	Office	College of Alameda	D	3	17.5	Meets target	0	92	400
35	<u>D215</u>	Occupiable Storage (Dry)	College of Alameda	D	3	4.9	Meets target	0	209	38
36	<u>D216</u>	Office	College of Alameda	D	3	34.6	Meets target	0	58	400
37	<u>D217</u>	Office	College of Alameda	D	3	34.4	Meets target	0	57	400
38	<u>D218</u>	OFFICE	College of Alameda	D	3	13.0	Meets target	0	57	0
39	<u>D219</u>	Office	College of Alameda	D	3	11.4	Meets target	0	57	0
40	<u>D207</u>	Classroom	College of Alameda	D	3	6.4	Meets target	0	416	0
41	<u>D222</u>	Classroom	College of Alameda	D	4	12.8	Meets target	0	758	1200
42	<u>D227</u>	Lobby	College of Alameda	D	3	3.7	Meets target	0	265	0
43	<u>D225</u>	Office	College of Alameda	D	3	11.7	Meets target	0	46	0
44	<u>D226</u>	Office	College of Alameda	D	3	12.7	Meets target	0	37	0
45	<u>D224</u>	Office	College of Alameda	D	3	6.9	Meets target	0	40	0
46	D227A	Office	College of Alameda	D	3	16.5	Meets target with mitigation	30	33	167
47	<u>D228</u>	Conference	College of Alameda	D	3	8.9	Meets target	0	324	0
48	<u>D230</u>	Lecture Room	College of Alameda	D	3	4.8	Meets target with mitigation	59	202	167
49	<u>D232</u>	Occupiable Storage (Dry)	College of Alameda	D	3	16.3	Meets target with mitigation	31	34	167

#		HVAC	Site			Α	Air Changes	Reccomendation		Mitigation
#	Room	Туре	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply	Applied CADR
50	D232A	Office	College of Alameda	D	3	12.5	Meets target	0	49	0
51	<u>D302</u>	Classroom	College of Alameda	D	3	4.1	Meets target	0	1321	0
52	<u>D307</u>	Classroom	College of Alameda	D	3	4.4	Meets target	0	1000	0
53	<u>D306</u>	Office	College of Alameda	D	3	8.4	Meets target	0	105	0
54	<u>D310</u>	Classroom	College of Alameda	D	3	5.1	Meets target	0	726	0
55	<u>D314</u>	Lecture Room	College of Alameda	D	3	5.7	Meets target	0	1321	0
56	<u>D315</u>	Classroom	College of Alameda	D	3	4.9	Meets target	0	803	0
57	D315 Office	Office	College of Alameda	D	3	10.4	Meets target	0	63	0
58	<u>D320</u>	Office	College of Alameda	D	3	14.9	Meets target	0	47	0
59	<u>D317</u>	Occupiable Storage (Dry)	College of Alameda	D	3	7.5	Meets target	0	104	0
60	<u>D318</u>	Occupiable Storage (Dry)	College of Alameda	D	3	8.9	Meets target	0	90	0
61	<u>D103</u>	Wood/Metal Shop	College of Alameda	D	3	11.1	Meets target	0	546	0
62	CLEAN ROOM	Wood/Metal Shop	College of Alameda	D	3	3.7	Meets target	0	58	0
63	<u>D104</u>	Wood/Metal Shop	College of Alameda	D	3	3.0	Meets target with mitigation	169	186	167
64	<u>D103A</u>	Wood/Metal Shop	College of Alameda	D	3	6.8	Meets target with mitigation	73	81	167
65	<u>D114B</u>	Occupiable Storage (Dry)	College of Alameda	D	3	9.8	Meets target	0	90	0
66	<u>D236</u>	Occupiable Storage (Dry)	College of Alameda	D	3	3.0	Meets target with mitigation	177	195	167