


Ventilation Assessment Summary

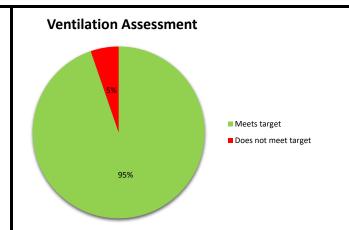

	#	HVAC		Site		Air Changes				<u>Halo</u>	<u>OR</u>	<u>PAC</u>		BSE-A-1000	
	#	Room	Туре	Campus	Building	Target	Actual	Result	Min. CADR	120 cfm		100 cfm	300 cfm	1065 CFM	
ſ	1	<u>G118A</u>	Music	College of Alameda	G + Gym	4	2.7	Does not meet target	103	1		1			
	2	<u>G116A</u>	Office	College of Alameda	G + Gym	3	5.2	Meets target	0						
	3	<u>G119</u>	Music	College of Alameda	G + Gym	3	8.6	Meets target	0						
	4	G111	Dance/Aerobics	College of Alameda	G + Gym										
	5	G129	Office	College of Alameda	G + Gym	3	6.8	Meets target	0						
	6	G130	Office	College of Alameda	G + Gym	3	3.3	Meets target	0						
	7	G132	Locker Room	College of Alameda	G + Gym	3	5.0	Meets target	0						
	8	G124	Locker Room	College of Alameda	G + Gym	3	3.7	Meets target	0						
	9	G127	Laundry Room	College of Alameda	G + Gym	3	27.0	Meets target	0						
	10	G124B	Locker Room	College of Alameda	G + Gym	3	4.7	Meets target	0						
	11	G124A	Office	College of Alameda	G + Gym	3	3.3	Meets target	0						
	12	G214	Weight Room	College of Alameda	G + Gym	3	3.4	Meets target	0						
	13	G214A	Office	College of Alameda	G + Gym	3	3.3	Meets target	0						
	14	G234	Office	College of Alameda	G + Gym	3	11.9	Meets target	0						
	15	G233	Office	College of Alameda	G + Gym	3	11.5	Meets target	0						
	16	G231	Computer	College of Alameda	G + Gym	3	14.5	Meets target	0						
	17	G235	Office	College of Alameda	G + Gym	3	14.0	Meets target	0						
	18	G232	Office	College of Alameda	G + Gym	3	18.9	Meets target	0						
	19	G229	Locker Room	College of Alameda	G + Gym	3	6.9	Meets target	0						
	20	G222	Office	College of Alameda	G + Gym	3	4.3	Meets target	0						