


Ventilation Assessment Summary

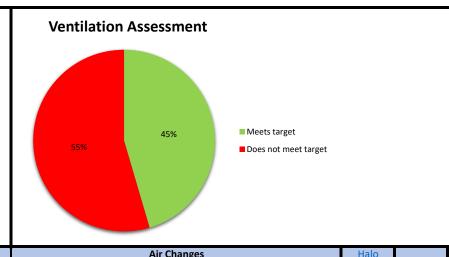

#	HVAC Site			Air Changes				<u>Halo</u>		PAC	BSE-A-1000	
	Room	Туре	Campus	Building	Target	Actual	Result	Min. CADR	120 cfm		100 cfm	1065 CFM
1	<u>L115</u>	Break room	College of Alameda	Library	3	0.0	Does not meet target	102	1		1	
2	L119	Office	College of Alameda	Library	3	7.0	Meets target	0				
3	L118	Library	College of Alameda	Library	3	7.1	Meets target	0				
4	L121	Office	College of Alameda	Library	3	0.0	Does not meet target	94	1		1	
5	<u>L120</u>	Office	College of Alameda	Library	3	0.0	Does not meet target	104	1		1	
6	L106	Office	College of Alameda	Library	3	0.0	Does not meet target	101	1		1	
7	L107	Conference	College of Alameda	Library	3	0.0	Does not meet target	53	1		1	
8	L108	Conference	College of Alameda	Library	3	0.0	Does not meet target	55	1		1	
9	L109	Conference	College of Alameda	Library	3	0.0	Does not meet target	98	1		1	
10	10A & L11	Office	College of Alameda	Library	3	0.0	Does not meet target	72	1		1	
11	L231	Reception Areas	College of Alameda	Library	3	3.7	Meets target	0		<u>OR</u>		
12	L235	Office	College of Alameda	Library	3	15.5	Meets target	0				
13	L236	Office	College of Alameda	Library	3	14.3	Meets target	0				
14	L226 (2/2	Conference	College of Alameda	Library	3	7.6	Meets target	0				
15	L237	Conference	College of Alameda	Library	3	7.9	Meets target	0				
16	L234	Select Category	College of Alameda	Library								
17	<u>L102</u>	Library	College of Alameda	Library	3	3.2	Meets target	7165				7
18	L223	Office	College of Alameda	Library	3	8.0	Meets target	0				
19	L226 (1/2)	Break room	College of Alameda	Library	3	10.9	Meets target	0				
20	L227	Office	College of Alameda	Library	3	0.0	Does not meet target	52	1		1	
21	L228	Office	College of Alameda	Library	3	0.0	Does not meet target	98	1		1	
22	L229	Office	College of Alameda	Library	3	0.0	Does not meet target	55	1		1	
23	L230	Office	College of Alameda	Library	3	0.0	Does not meet target	75	1		1	