


Ventilation Assessment Summary

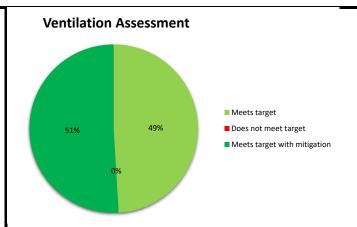

| # | HVAC | | | Site | | Air Changes | | | Recommendation | |
|----|------------------|------------|------------------|----------------------|--------|-------------|------------------------------|-----------|----------------|--------------|
| # | Room | Туре | Campus | Building | Target | Actual | Result | Min. CADR | Min. Supply | Applied CADR |
| 1 | <u>A100</u> | Office | District Offices | Admissions & Records | 3 | 7.4 | Meets target | 0 | 54 | 0 |
| 2 | <u>A103</u> | Office | District Offices | Admissions & Records | 3 | 5.6 | Meets target | 0 | 111 | 0 |
| 3 | <u>A104</u> | Office | District Offices | Admissions & Records | 3 | 7.1 | Meets target | 0 | 51 | 0 |
| 4 | <u>A108</u> | Office | District Offices | Admissions & Records | 3 | 6.7 | Meets target | 0 | 52 | 0 |
| 5 | <u>A109</u> | Office | District Offices | Admissions & Records | 3 | 3.8 | Meets target | 0 | 86 | 0 |
| 6 | <u>A110</u> | Office | District Offices | Admissions & Records | 3 | 3.3 | Meets target | 0 | 181 | 0 |
| 7 | <u>A113</u> | Office | District Offices | Admissions & Records | 3 | 4.4 | Meets target with mitigation | 96 | 169 | 167 |
| 8 | <u>A111</u> | Conference | District Offices | Admissions & Records | 3 | 3.4 | Meets target | 0 | 96 | 0 |
| 9 | <u>A112</u> | Office | District Offices | Admissions & Records | 3 | 10.0 | Meets target | 0 | 52 | 0 |
| 10 | <u>A115</u> | Break room | District Offices | Admissions & Records | 3 | 7.8 | Meets target | 0 | 73 | 0 |
| 11 | <u>G175</u> | Conference | District Offices | DGS | 3 | 4.5 | Meets target with mitigation | 184 | 203 | 279 |
| 12 | <u>G165</u> | Break room | District Offices | DGS | 3 | 11.3 | Meets target | 0 | 216 | 0 |
| 13 | <u>G176</u> | Office | District Offices | DGS | 3 | 4.1 | Meets target with mitigation | 113 | 167 | 167 |
| 14 | <u>G189</u> | Conference | District Offices | DGS | 3 | 3.0 | Meets target | 2 | 84 | 0 |
| 15 | <u>G182</u> | Office | District Offices | DGS | 3 | 3.0 | Meets target with mitigation | 167 | 297 | 167 |
| 16 | <u>G190</u> | Office | District Offices | DGS | 3 | 8.9 | Meets target | 0 | 84 | 0 |
| 17 | <u>G192</u> | Office | District Offices | DGS | 3 | 4.1 | Meets target | 0 | 73 | 0 |
| 18 | <u>G191</u> | Office | District Offices | DGS | 3 | 12.6 | Meets target | 0 | 72 | 0 |
| 19 | <u>G183</u> | Office | District Offices | DGS | 3 | 8.9 | Meets target with mitigation | 56 | 62 | 167 |
| 20 | <u>G187</u> | Conference | District Offices | DGS | 3 | 5.5 | Meets target with mitigation | 57 | 148 | 167 |
| 21 | <u>G186</u> | Office | District Offices | DGS | 3 | 6.3 | Meets target | 0 | 1166 | 0 |
| 22 | Engineers | Office | District Offices | DGS | 3 | 6.4 | Meets target | 0 | 229 | 0 |
| 23 | <u>G177</u> | Lobby | District Offices | DGS | 3 | 3.9 | Meets target with mitigation | 450 | 627 | 613 |
| 24 | <u>G185</u> | Office | District Offices | DGS | 3 | 10.0 | Meets target with mitigation | 50 | 55 | 167 |

| # | HVAC | | Site | | Air Changes | | | Recommendation | | Mitigation |
|----|-----------------------|--------------------------|------------------|----------|-------------|--------|------------------------------|----------------|-------------|--------------|
| # | Room | Туре | Campus | Building | Target | Actual | Result | Min. CADR | Min. Supply | Applied CADR |
| 25 | <u>G188</u> | Conference | District Offices | DGS | 3 | 3.8 | Meets target with mitigation | 133 | 146 | 167 |
| 26 | <u>T164</u> | Office | District Offices | DGS | 3 | 11.9 | Meets target with mitigation | 23 | 53 | 167 |
| 27 | <u>T163</u> | Office | District Offices | DGS | 3 | 11.2 | Meets target with mitigation | 45 | 49 | 167 |
| 28 | <u>T162</u> | Office | District Offices | DGS | 3 | 11.7 | Meets target with mitigation | 27 | 53 | 167 |
| 29 | <u>T161</u> | Office | District Offices | DGS | 3 | 11.2 | Meets target with mitigation | 45 | 49 | 167 |
| 30 | <u>T155</u> | Office | District Offices | DGS | 3 | 18.5 | Meets target | 0 | 96 | 0 |
| 31 | <u>T153</u> | Office | District Offices | DGS | 3 | 51.7 | Meets target | 0 | 48 | 0 |
| 32 | <u>T151</u> | Office | District Offices | DGS | 3 | 3.5 | Meets target | 0 | 48 | 0 |
| 33 | <u>T143</u> | Office | District Offices | DGS | 3 | 12.5 | Meets target with mitigation | 26 | 49 | 167 |
| 34 | <u>T141</u> | Office | District Offices | DGS | 3 | 10.5 | Meets target with mitigation | 48 | 53 | 167 |
| 35 | <u>T154</u> | Conference | District Offices | DGS | 3 | 6.3 | Meets target with mitigation | 45 | 122 | 167 |
| 36 | <u>T149</u> | Office | District Offices | DGS | 3 | 10.0 | Meets target with mitigation | 50 | 55 | 167 |
| 37 | <u>T139</u> | Office | District Offices | DGS | 3 | 14.1 | Meets target with mitigation | 14 | 46 | 167 |
| 38 | <u>T137</u> | Office | District Offices | DGS | 3 | 15.5 | Meets target with mitigation | 12 | 41 | 167 |
| 39 | <u>T152</u> | Computer Lab | District Offices | DGS | 3 | 7.0 | Meets target with mitigation | 42 | 105 | 167 |
| 40 | <u>T-Lobby</u> | Reception Areas | District Offices | DGS | 3 | 3.5 | Meets target with mitigation | 566 | 1032 | 725 |
| 41 | <u>P110</u> | Occupiable Storage (Dry) | District Offices | DGS | 3 | 19.8 | Meets target | 0 | 241 | 0 |
| 42 | Warehouse(1) | Occupiable Storage (Dry) | District Offices | DGS | 3 | 3.3 | Meets target with mitigation | 1771 | 1949 | 1953 |
| 43 | <u>P117</u> | Office | District Offices | DGS | 3 | 5.1 | Meets target with mitigation | 98 | 107 | 167 |
| 44 | <u>P108</u> | Office | District Offices | DGS | 3 | 5.1 | Meets target | 0 | 96 | 0 |
| 45 | <u>P107</u> | Office | District Offices | DGS | 3 | 3.6 | Meets target | 0 | 96 | 0 |
| 46 | <u>P101</u> | Office | District Offices | DGS | 3 | 3.0 | Meets target | 4 | 143 | 0 |
| 47 | <u>P102</u> | Office | District Offices | DGS | 3 | 4.8 | Meets target | 0 | 80 | 0 |
| 48 | <u>P103</u> | Office | District Offices | DGS | 3 | 8.9 | Meets target with mitigation | 23 | 81 | 167 |
| 49 | <u>P106</u> | Office | District Offices | DGS | 3 | 7.5 | Meets target | 0 | 65 | 0 |
| 50 | Purchasing Dept Lobby | Reception Areas | District Offices | DGS | 3 | 5.8 | Meets target | 0 | 446 | 0 |
| 51 | <u>M1</u> | Reception Areas | District Offices | DGS | 3 | 3.3 | Meets target with mitigation | 150 | 165 | 167 |
| 52 | <u>M1</u> | Office | District Offices | DGS | 3 | 9.6 | Meets target with mitigation | 52 | 57 | 167 |
| 53 | <u>M3</u> | Occupiable Storage (Dry) | District Offices | DGS | 3 | 7.7 | Meets target with mitigation | 65 | 72 | 167 |