


Ventilation Assessment Summary

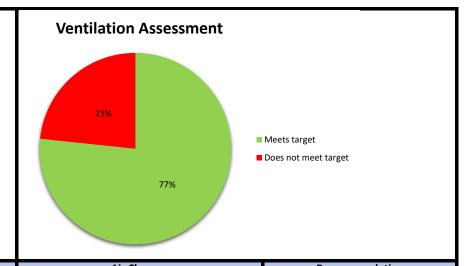

#	HVAC		Site			Air Ch	anges	Recommendation	
#	Room	Туре	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply
1	<u>F200</u>	Classroom	Laney College	Building F	5	7.9	Meets target	0	540
2	<u>F201</u>	Classroom	Laney College	Building F	7	9.1	Meets target	0	722
3	<u>F202</u>	Classroom	Laney College	Building F	4	7.2	Meets target	0	661
4	<u>F203</u>	Classroom	Laney College	Building F	4	9.4	Meets target	0	662
5	F204	Classroom	Laney College	Building F	5	9.0	Meets target	0	544
6	<u>F205</u>	Classroom	Laney College	Building F	4	8.6	Meets target	0	617
7	<u>F250</u>	Office	Laney College	Building F	3	6.1	Meets target	0	233
8	<u>F251</u>	Classroom	Laney College	Building F	3	6.8	Meets target	0	529
9	<u>F252</u>	Classroom	Laney College	Building F	3	7.7	Meets target	0	493
10	<u>B253</u>	Classroom	Laney College	Building F	3	7.1	Meets target	0	493
11	<u>F254B</u>	Office	Laney College	Building F	3	6.8	Meets target	0	70
12	<u>F254</u>	Classroom	Laney College	Building F	3	5.4	Meets target	0	896
13	<u>F255</u>	Classroom	Laney College	Building F	5	6.9	Meets target	0	542
14	F254C	Occupiable Storage (Dry)	Laney College	Building F	3	7.2	Meets target	0	82
15	<u>F170</u>	Office	Laney College	Building F	3	0.0	Does not meet target	855	941
16	<u>F170A</u>	Computer Lab	Laney College	Building F	3	4.2	Meets target	0	692
17	170 A Staff Office	Computer	Laney College	Building F	3	2.8	Does not meet target	18	346
18	<u>F170C</u>	Computer Lab	Laney College	Building F	3	6.3	Meets target	0	1794
19	<u>F170D</u>	Computer Lab	Laney College	Building F	3	4.6	Meets target	0	706
20	<u>F170B</u>	Computer Lab	Laney College	Building F	3	4.1	Meets target	0	1674
21	<u>F170D,2</u>	Conference	Laney College	Building F	3	8.8	Meets target	0	387
22	<u>F160</u>	Locker Room	Laney College	Building F	3	0.0	Does not meet target	294	323
23	<u>F150</u>	Wood/Metal Shop	Laney College	Building F	3	4.3	Meets target	0	11356
24	<u>F152C</u>	Occupiable Storage (Dry)	Laney College	Building F	3	0.0	Does not meet target	156	171

#	HVAC		Site		Air Changes			Recommendation	
#	Room	Туре	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply
25	<u>F152B</u>	Office	Laney College	Building F	3	10.5	Meets target	0	74
26	F152A	Occupiable Storage (Dry)	Laney College	Building F	3	0.0	Does not meet target	311	342
27	F153A	Office	Laney College	Building F	3	5.0	Meets target	0	77
28	F153B	Office	Laney College	Building F	3	7.5	Meets target	0	62
29	F153C	Occupiable Storage (Dry)	Laney College	Building F	3	0.0	Does not meet target	162	179
30	F153E	Occupiable Storage (Dry)	Laney College	Building F	3	0.0	Does not meet target	267	294