


Ventilation Assessment Summary

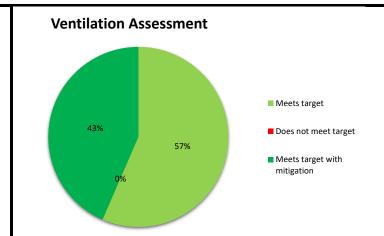

#	HVAC		Site		Air Changes			Recommendation		Mitigation
#	Room	Туре	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply	Applied CADR
1	<u>L110</u>	Break room	Laney College	Library	3	3.9	Meets target with mitigation	303	564	460
2	<u>L108</u>	Occupiable Storage (I	Laney College	Library	3	10.8	Meets target	0	90	0
3	<u>L114</u>	Office	Laney College	Library	3	3.7	Meets target with mitigation	553	685	690
4	<u>L102</u>	Office	Laney College	Library	3	3.6	Meets target	0	289	0
5	<u>L104</u>	Computer Lab	Laney College	Library	3	3.2	Meets target with mitigation	431	507	460
6	<u>L101</u>	Computer Lab	Laney College	Library	3	4.3	Meets target with mitigation	269	477	460
7	<u>L109</u>	Office	Laney College	Library	3	4.9	Meets target	0	413	0
8	<u>L110A</u>	Office	Laney College	Library	3	19.3	Meets target with mitigation	10	44	230
9	<u>L202</u>	Office	Laney College	Library	3	3.1	Meets target	0	60	0
14	Stacks 2	Library	Laney College	Library	3	3.0	Meets target with mitigation	1999	11453	1900
15	L304	Conference	Laney College	Library	3	5.0	Meets target	0	63	0
16	L306	Conference	Laney College	Library	3	4.9	Meets target	0	63	0
17	L308	Conference	Laney College	Library	3	5.2	Meets target	0	63	0
18	<u>L310</u>	Conference	Laney College	Library	3	13.7	Meets target with mitigation	24	63	230
19	<u>L312</u>	Conference	Laney College	Library	3	3.5	Meets target	0	130	0
20	<u>L313</u>	Conference	Laney College	Library	3	6.4	Meets target	0	63	0
21	<u>L311</u>	Conference	Laney College	Library	3	8.8	Meets target	0	64	0
22	<u>L309</u>	Conference	Laney College	Library	3	6.4	Meets target	0	64	0
23	L307	Office	Laney College	Library	3	5.0	Meets target	0	64	0
24	L305	Office	Laney College	Library	3	5.2	Meets target	0	133	0
27	Stacks 3	Library	Laney College	Library	3	3.4	Meets target with mitigation	1159	5653	1900
28	<u>L110B</u>	Office	Laney College	Library	3	17.8	Meets target with mitigation	39	43	230
29	L110C	Office	Laney College	Library	3	5.4	Meets target with mitigation	97	183	230